

Child Resistant Packaging Standards

This chart shows key sections of the standards to show variances among the standards. Check with the local authority for further clarification. These standards are for child resistant protocol testing only. Several other standards apply for child resistant packages (i.e., durability, markings, leakage, compatibility, etc.). Different standards are used for child resistant protocol testing for portable fuel containers, cigarette lighters, and multi-purpose lighters.

Topic	16 CFR 1700	CSA Z76.1	40 CFR 157	ISO 8317	ISO 14375	EN ISO 28862
Title	Poison Prevention Packaging Act (PPPA) of 1970 Regulations.	Reclosable child-resistant packages.	Requirements for child-resistant packaging of pesticide products and devices.	Child-resistant packaging—requirements and testing procedures for reclosable packages.	Child-resistant non-reclosable packaging for pharmaceutical products.	Requirements and testing procedures for non-reclosable packages for non-pharmaceutical products.
Authority	United States Consumer Product Safety Commission (CPSC) (as given authority by the PPPA).	Canadian Standards Association (CSA)	United States Environmental Protection Agency (EPA)	International Standards Organization (ISO/IEC)	International Standards Organization (ISO)	International Standards Organization (ISO)
Regulates	Packaging for any substance deemed hazardous by CPSC (see 1700.14 for list) sold for use in or around the household.	Reclosable child-resistant packages (this does not apply to non-reclosable packages).	Established under the authority of FIFRA section 25(a)(1) and 25(c)(3) which authorizes standards for package, container or wrapping for pesticide or device.	Reclosable packages designated as child resistant.	Non-reclosable packaging designated as child resistant.	Child-resistant, non-reclosable, non-pharmaceutical packaging.
Necessary Client Prep and Package Definition	1700.1 <i>Package</i> means immediate package is tested. 1700.20 <i>Tamper-resistant feature</i> of the package shall be removed prior to testing unless it is part of the child-resistant design. 1700.20 <i>Reclosable packages</i> , the caps are applied using the online torque value at least 72 hours prior to testing. 1700.20 <i>Standardized Child Test Instructions: Reclosable packages</i> shall be opened and properly resecured one time (or more) by tester or another adult prior to child test.	8.1.1 Non immediate packaging is removed. 8.1.4.g) tamper evident materials are removed. 8.1.4.f) All packages shall contain a placebo.	157.21 Immediate container or wrapping, including any attached closures. 157.27 Packaging for each unit <i>or</i> for the outer retail container which houses the units.	3.1.1 Only new packages should be tested; each child is given a new package to test. 4.3 Packages are opened and closed once before testing. All tamper evident material is removed. 4.3 Placebo is to be used; quantities are specified.	5.2 Packages for the child panel test shall be unprinted. Each sample package shall be checked for integrity before the test is conducted. There shall be at least 10 unit doses for each child and adult.	5.2 Packages for the child panel test shall be unprinted. Each sample packages shall be checked for integrity before the test.

Child Resistant Packaging Standards

This chart shows key sections of the standards to show variances among the standards. Check with the local authority for further clarification. These standards are for child resistant protocol testing only. Several other standards apply for child resistant packages (i.e., durability, markings, leakage, compatibility, etc.). Different standards are used for child resistant protocol testing for portable fuel containers, cigarette lighters, and multi-purpose lighters.

Topic	16 CFR 1700	CSA Z76.1	40 CFR 157	ISO 8317	ISO 14375	EN ISO 28862
Child Panel Composition/ Standards	1700.20 <i>Child Test</i> : <ul style="list-style-type: none"> • ≤20% from any site • 30% 42-44 months; 40% 45-48 months; 30% 49-51 months • 50% male/female ratio within 10% in each of the three age groups • ≤30% tested by any one tester • Maximum of two packages tested per child; must be of different ASTM types 	8.1.2 For 200 child panel: <ul style="list-style-type: none"> • 40 ± 4 children from each two-month age (42-43, 44-45 months, etc.) • ≤60% of any age group from the same sex 9.2 For sequential panel (for child panel only that is not part of a resealing test): A minimum of 30 children using grid shown in Figure 1.	157.32 References testing protocol of 16 CFR 1700.20.	3.3.1.2: For sequential panels, as few as 30 children can be tested; use Figures 1 and 2. 4.4.2 If a child is used on more than one test panel, it is desirable that there should be at least one week between the tests. 4.4.3 Test sites can be any location in child is relaxed; a minimum of 3 sites is needed. 4.4 No tester limitations.	5.3.2.1 If a child is used for more than one test there shall be at least 4 weeks between tests. Parental or guardian consent shall be obtained before the child is used as part of the test group. Exclude children involved in a reported poisoning accident. 5.3.2.2 Test personnel should visit the site beforehand and become known to the children. No tester limitations.	5.3.2.1 If a child is used for more than one test there shall be at least 4 weeks between tests. Parental or guardian consent shall be obtained before the child is used as a part of the test group. Exclude children involved in a reported poisoning accident. 5.3.2.2 Test personnel should visit the site beforehand and become known to the children. No tester limitations.
Sequential Testing	1700.20 <i>Sequential test</i> : Use Table 1; minimum of 50 children.	9.2 Use Figures 1 & 2; minimum of 30 children	16 CFR 1700.20 Use Table 1; minimum of 50 children.	3.3.1.2 Use Figures 1 & 2; minimum of 30 children.	5.4.1.1 Use Figures B1 & B2; minimum of 30 children.	5.4.1.3.1 Using Figures B1 & B2; minimum of 30 children.
Access to Tools	Tools are not discussed in the protocol. CPSC staff has suggested not giving any tools to the children unless they are included in retail unit of sale. Adults are given tools/implements if their use is explicit in the opening directions.	Tools are not discussed in the protocol.	Tools are not discussed in the protocol.	4.4.4 No tools are accessible unless supplied as part of the design; if tools are included, attention shall not be drawn to the tools until it is used in the demonstration.	5.3.2.2. No tools shall be accessible unless supplied at point of sale. 5.3.2.2. When tools are needed to open the package, but these are not supplied by the manufacturer, there shall be no demonstration. The test is therefore limited to the first 5 min test period.	5.3.2.2 No tools or implements shall be accessible which might be used by the child, other than those supplied by the manufacturer or packer at the point of sale. When tools are needed to open the package, but these are not supplied by the manufacturer, there shall be no demonstration. The test is therefore limited to the first 5 min test period.
Placebo or Substitute Product	The use of placebo is not discussed in the regulation. For unit dose packages, CPSC staff has recommended using a proper substitute that responses like the intended contents. For other packages, appropriate placebo is used to simulate proper use of the package/dispensing product.	8.1.4 f) All packages shall contain a placebo. Packages shall be filled 1/2 to 2/3 full of the placebo.		4.3 A suitable substitute product (placebo) shall be used for both the adult and child tests. When a substitute product is used, packages up to a volume of 1 L shall be filled to their normal size capacity (i.e., as sold); packages greater than 1 L volume shall be filled with 1 kg of solid or 1 L of liquid.	5.2 The material and design of the test samples shall conform to the technical specification and they shall be representative of an average batch of original packages.	5.2 An appropriate substitute product shall be used.

Child Resistant Packaging Standards

This chart shows key sections of the standards to show variances among the standards. Check with the local authority for further clarification. These standards are for child resistant protocol testing only. Several other standards apply for child resistant packages (i.e., durability, markings, leakage, compatibility, etc.). Different standards are used for child resistant protocol testing for portable fuel containers, cigarette lighters, and multi-purpose lighters.

Topic	16 CFR 1700	CSA Z76.1	40 CFR 157	ISO 8317	ISO 14375	EN ISO 28862
Performance Standards	1700.20 <i>Test failures</i> : Any child who opens the special packaging or gains access to its contents. Failure rate for unit dose packaging is based on toxicological data (or access to the 9 th dose). Failure is access in whole or in part.	8.1.4.i) A failure is when a child successfully opens the package.		5.1.1 The result of the test is a failure if the child succeeds in opening the package (or gaining access to the contents).	4.2.1 The test shall be considered a failure in relation to unit, strip or blister packages if within 10 min the child accesses more than eight unit doses from the packaging provided. NOTE: ...this does not address the issue of toxicity.	4.2.1 An individual child test shall be considered a failure in relation to a single use package if the child gains access to one or more units from the packaging provided.
Adult Panel Composition	1700.20 <i>Senior-Adult Test</i> : <ul style="list-style-type: none"> • ≤24% from any site. • 25% 50-54 years; 25% 55-59 years; 50% 60-70 years. • 70% female in each of the three age groups • ≤35% tested by any one tester Maximum of two packages tested per sitting; different ASTM types	8.2.2 no tester and site limitations are noted. <ul style="list-style-type: none"> • 25% 50-54 years; 25% 55-59 years; 50% 60-70 years. • 70% female in each of the three age groups 8.2.5.o) Maximum of two packages tested per sitting; different ASTM types		4.4.4 No site or tester limitations.	5.2 For both the child and adult tests, there shall be at least 10 unit doses available for each participant. 5.3.3.2 No site or tester limitations.	4.2.2 Adult test is optional unless a tool is supplied to open the container at the point of sale. 5.3.3.1 No more than 30 adults for the panel shall be tested from one site; no tester shall test more than 35 of the panel.
Bracketing/Testing a Series of Packages	Bracketing is NOT discussed. The CPSC staff are open to discussing bracketing.	11.2 Defines an acceptable protocol test series for caps/liners, etc. Not all closure and cap sizes need to be tested.	157.36(c)(2) Registrant must always have test data or test data on a different package with supporting data to prove child resistance.	3.1.2 Details the range of caps and containers in a series that should be tested to reflect the entire series.		
Observers	This is not discussed in the regulation.	8.1.4 c) d) Limit the interaction between the parent, guardian or teacher and inform them they are not part of the testing process.		4.4.1.2 Parents should not be involved or present during testing.	5.3.2.2. No observers should be present or near testing (no parents should observe).	
Adult screening	1700.20 <i>Test Instructions for Senior Test</i> : Adults unable to open the first package in 5 minutes are asked to open two standard packages with non-CR caps. If this is successful, the participant is included in the panel and counted as a failure. Adults must read and sign a consent form.	8.2.3.1 Participants who are unable to open the first package in 5 minutes are asked to open two standard packages with non-CR caps. If this is successful, the participant is included in the panel and counted as a failure. 8.2.5 b) Adult shall read and sign a consent form.		4.5.2 Use screening question: Are you professionally concerned with the design, manufacture or use of child-resistant packaging? Answer must be negative.	5.3.3.1 Use screening questions (and answers must be negative): 1. Are you professionally concerned with the design, manufacture or use of child-resistant packaging? 2. Have you taken part in more than one previous child resistant packaging test within the last 6 months?	5.3.3.1 Use screening question: Are you professionally concerned with the design, manufacture or use of child-resistant packaging?

Child Resistant Packaging Standards

This chart shows key sections of the standards to show variances among the standards. Check with the local authority for further clarification. These standards are for child resistant protocol testing only. Several other standards apply for child resistant packages (i.e., durability, markings, leakage, compatibility, etc.). Different standards are used for child resistant protocol testing for portable fuel containers, cigarette lighters, and multi-purpose lighters.

Topic	16 CFR 1700	CSA Z76.1	40 CFR 157	ISO 8317	ISO 14375	EN ISO 28862
Certification/ Submissions	1700.14 <i>Sample packages:</i> The manufacturer or packer of a regulated substance should submit a sample to the CPSC. 1700.20 <i>Records:</i> It is recommended that summary data be given to the CPSC. (Note per the CPSIA, companies putting regulated substances into the market must self-publish a GCC.)		157.34(a) Registrant shall certify to the FDA that packaging meets the stands of 16 CFR 1700.20.			
Life Testing	1700.15 <i>General Requirements:</i> Packages should be opened/closed to represent the life of the package.	12.3 Packages are opened and closed by trained individuals to replicate the lifetime of the package.				
Directive to Child to Use Teeth	1700.20 <i>Standardized Child Test Instructions:</i> If one or both children have not used their teeth to try to open their packages during the first 5 minutes, tester says: <i>You can use your teeth if you want to.</i>	8.1.5 Children are NOT told to use their teeth after the demonstration.		4.4.4 The child is to be told to use whatever means he wants; teeth are not discouraged; however, child are NOT told to use their teeth after the demonstration.	5.3.2.2. No attempt is made to keep a child from using teeth; no permission to use teeth is vocalized.	5.3.2.2 . No attempt is made to keep a child from using teeth; no permission to use teeth is vocalized.

Child Resistant Packaging Standards

This chart shows key sections of the standards to show variances among the standards. Check with the local authority for further clarification. These standards are for child resistant protocol testing only. Several other standards apply for child resistant packages (i.e., durability, markings, leakage, compatibility, etc.). Different standards are used for child resistant protocol testing for portable fuel containers, cigarette lighters, and multi-purpose lighters.

Test panel	Cumulative number of children	Package openings					
		First 5 minutes			Full 10 minutes		
		Pass	Continue	Fail	Pass	Continue	Fail
1	50	0-3	4-10	11+	0-5	6-14	15+
2	100	4-10	11-18	19+	6-15	16-24	25+
3	150	11-18	19-25	26+	16-25	26-34	35+
4	200	19-30	31+	26-40	41+

Table 1. Pass, continue, and fail criteria for 16 CFR 1700

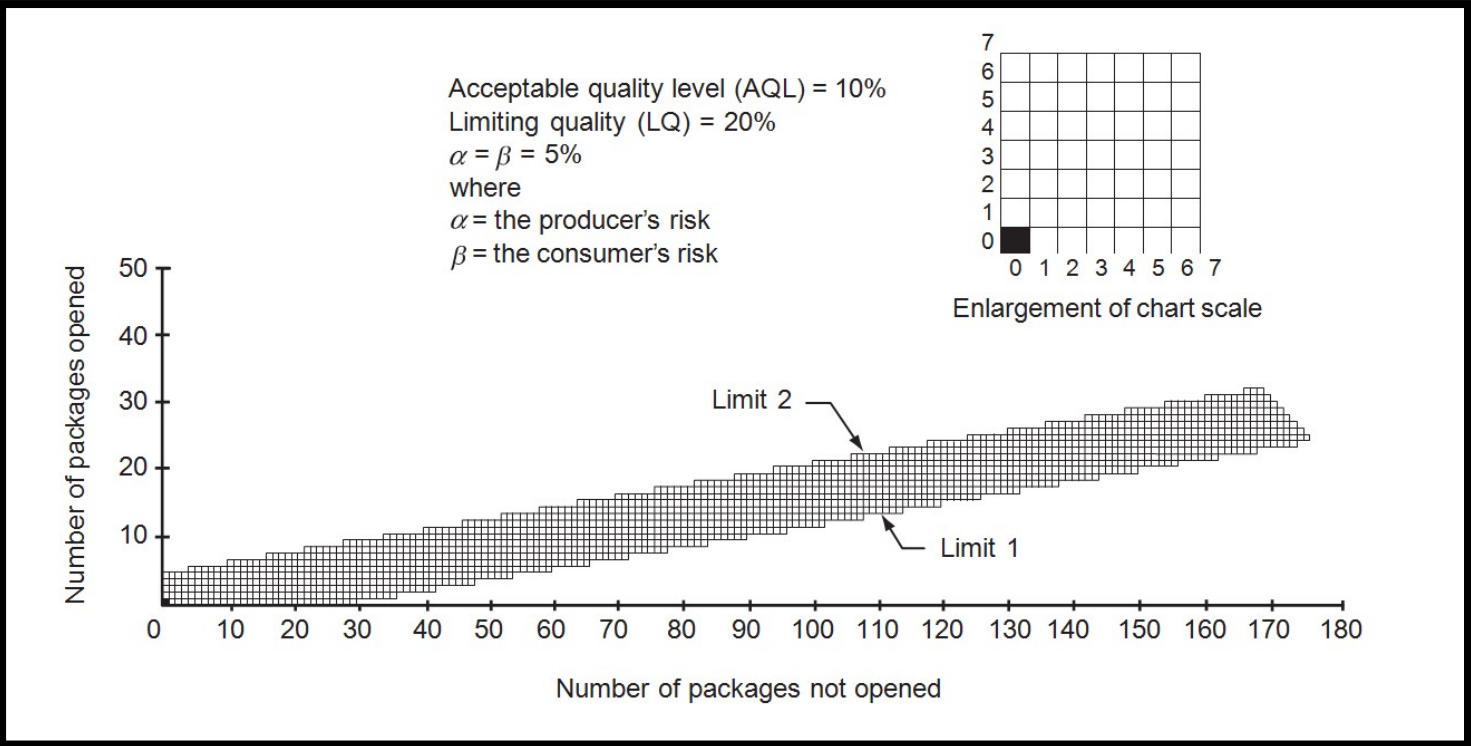


Figure 1/ Figure 1B. Chart of a sequential child-resistant effectiveness test procedure (without demonstration) for reclosable child-resistant packages

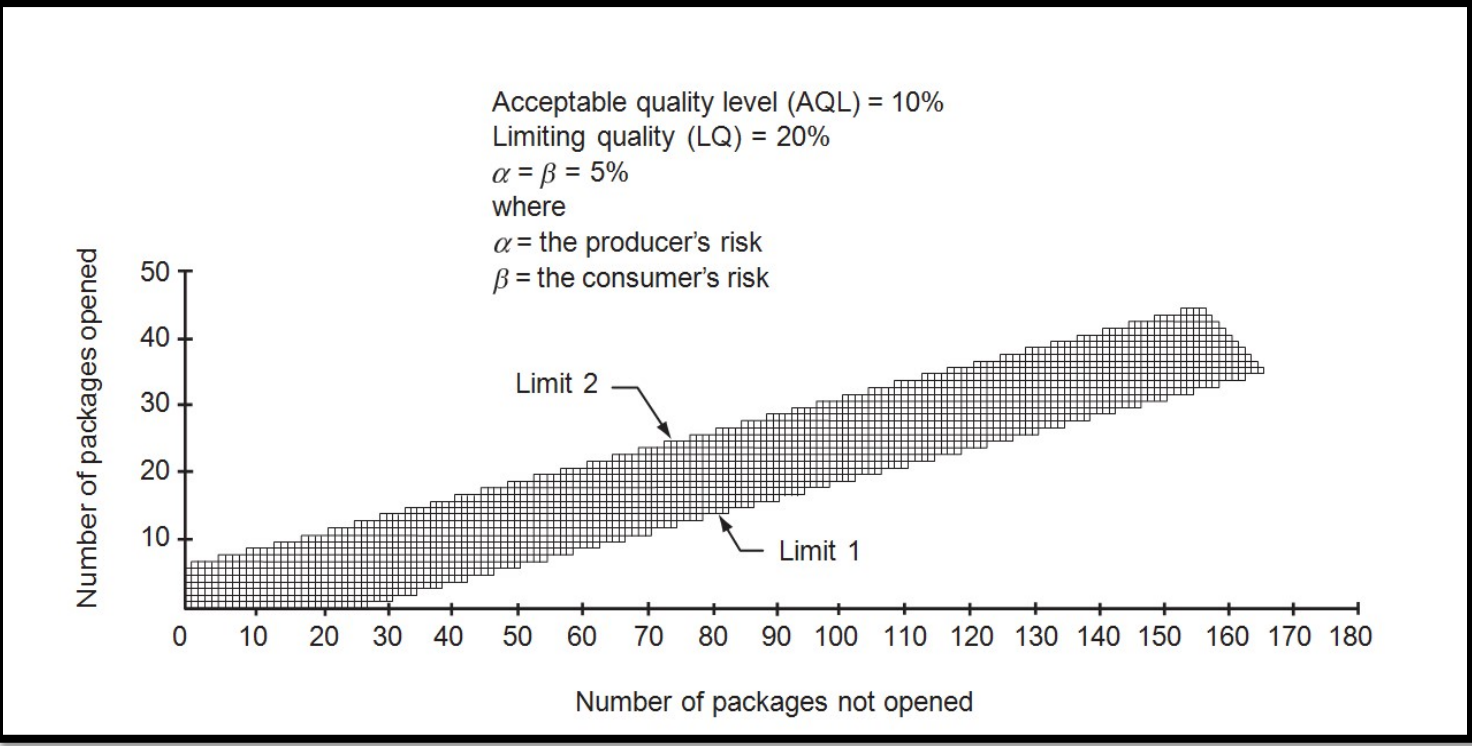


Figure 2 /Figure 2B. Chart of a sequential child-resistant effectiveness test procedure (after demonstration) for reclosable child-resistant packages